


NOTE:

FOR P.C.C. STREETS PAVEMENT REPLACEMENT SHALL BE 1" THICKER THAN EXISTING (6" MINIMUM)


DEEP LIFT A.C., THICKNESS TO BE DETERMINED BY THE ENGINEER
 (6" THICK A.C. FOR RESIDENTIAL STREETS
 12" - 18" THICK A.C. FOR ARTERIAL STREETS)

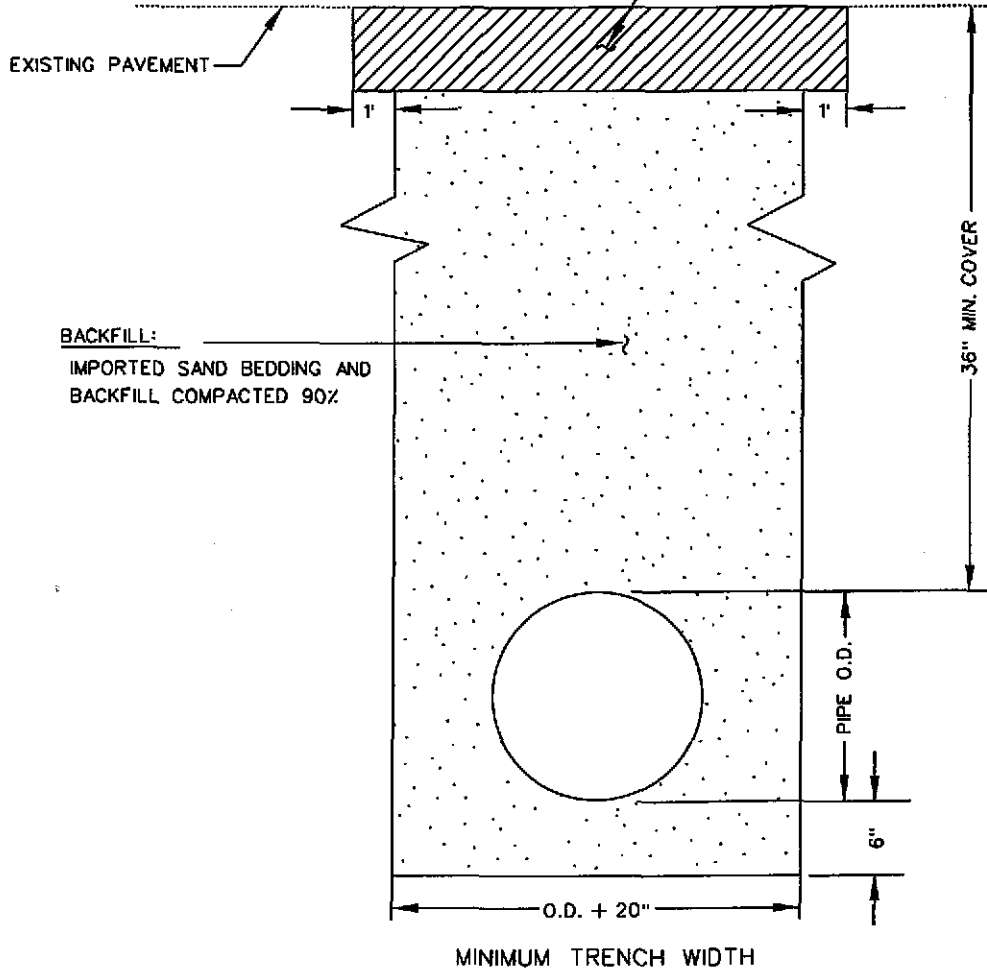

WATER MAIN TRENCH DETAIL N.T.S.

NOTE: SPECIAL REQUIREMENTS FOR ARTERIAL STREETS

FOR ALL TRENCH PAVING ON ARTERIAL STREETS, THE A.C. BASE COURSE SHALL BE INITIALLY CONSTRUCTED FLUSH WITH ADJACENT PAVEMENT. FOLLOWING 2-3 WEEKS OF TRAFFIC LOADING, THE CONTRACTOR SHALL GRIND THE TOP 1 1/2" OFF THE TRENCH BASE COURSE AND INSTALL THE SURFACE COURSE



APPROVED: DATE: 3/20/2011

Raymond L. Bush

CITY OF SANTA ANA
 PUBLIC WORKS AGENCY

| DATE | REVISION |
|---------|--|
| 8/19/03 | A.F. SPECIAL REQUIREMENTS FOR ARTERIAL STREETS ADDED |
| 4/28/05 | A.F. WORDING ADDED |
| 3/10/11 | A.F. WORDING ON TRENCH WIDTH |

WATER MAIN TRENCH DETAIL

STD. PLAN NUMBER
 1428